


Professional Testing Labs, Inc

4918 Crater Lake Ave.
Medford, OR 97504
(541) 836-4066
OLCC# 10156338460

Certificate of Analysis

Not For OLCC/OHA regulatory compliance
For informational purposes only

Report Number: _230902

Report Date: 09/12/2023


Indoor Orange Gas

Sample Type: MJ Flower	Sampling Method: SOP 023	Lab Sample ID: 23090204_1	Sampling Method: SOP 023
Matrix Batch ID: N/A	License: N/A	Testing Performed: PO	Harvest Date: N/A
Date Received: 09/11/2023	Comments and Descriptions:		

Cannabinoid Analysis

Analyte	% Dry Weight	LOQ (%)	Notes
CBDA	17.341	0.077	
CBD	0.476	0.077	
THC	<LOQ	0.077	
THCA	0.653	0.077	
CBDV	<LOQ	0.077	
CBGA	1.349	0.077	
CBG	<LOQ	0.077	
THCV	<LOQ	0.077	
CBN	<LOQ	0.077	
Δ8-THC	<LOQ	0.077	
Δ10-THC	<LOQ	0.077	
CBC	<LOQ	0.077	
CBCA	0.351	0.077	
Total CBD	15.684	(CBDA * 0.877) + CBD = Total CBD	
Total THC	0.573	(THCA * 0.877) + THC = Total THC	
Total Minors	1.700	SUM% of Minor Cannabinoids	
Total Cannabinoids	20.170	Sum % Cannabinoids = Total Cannabinoids	

% Dry Weight

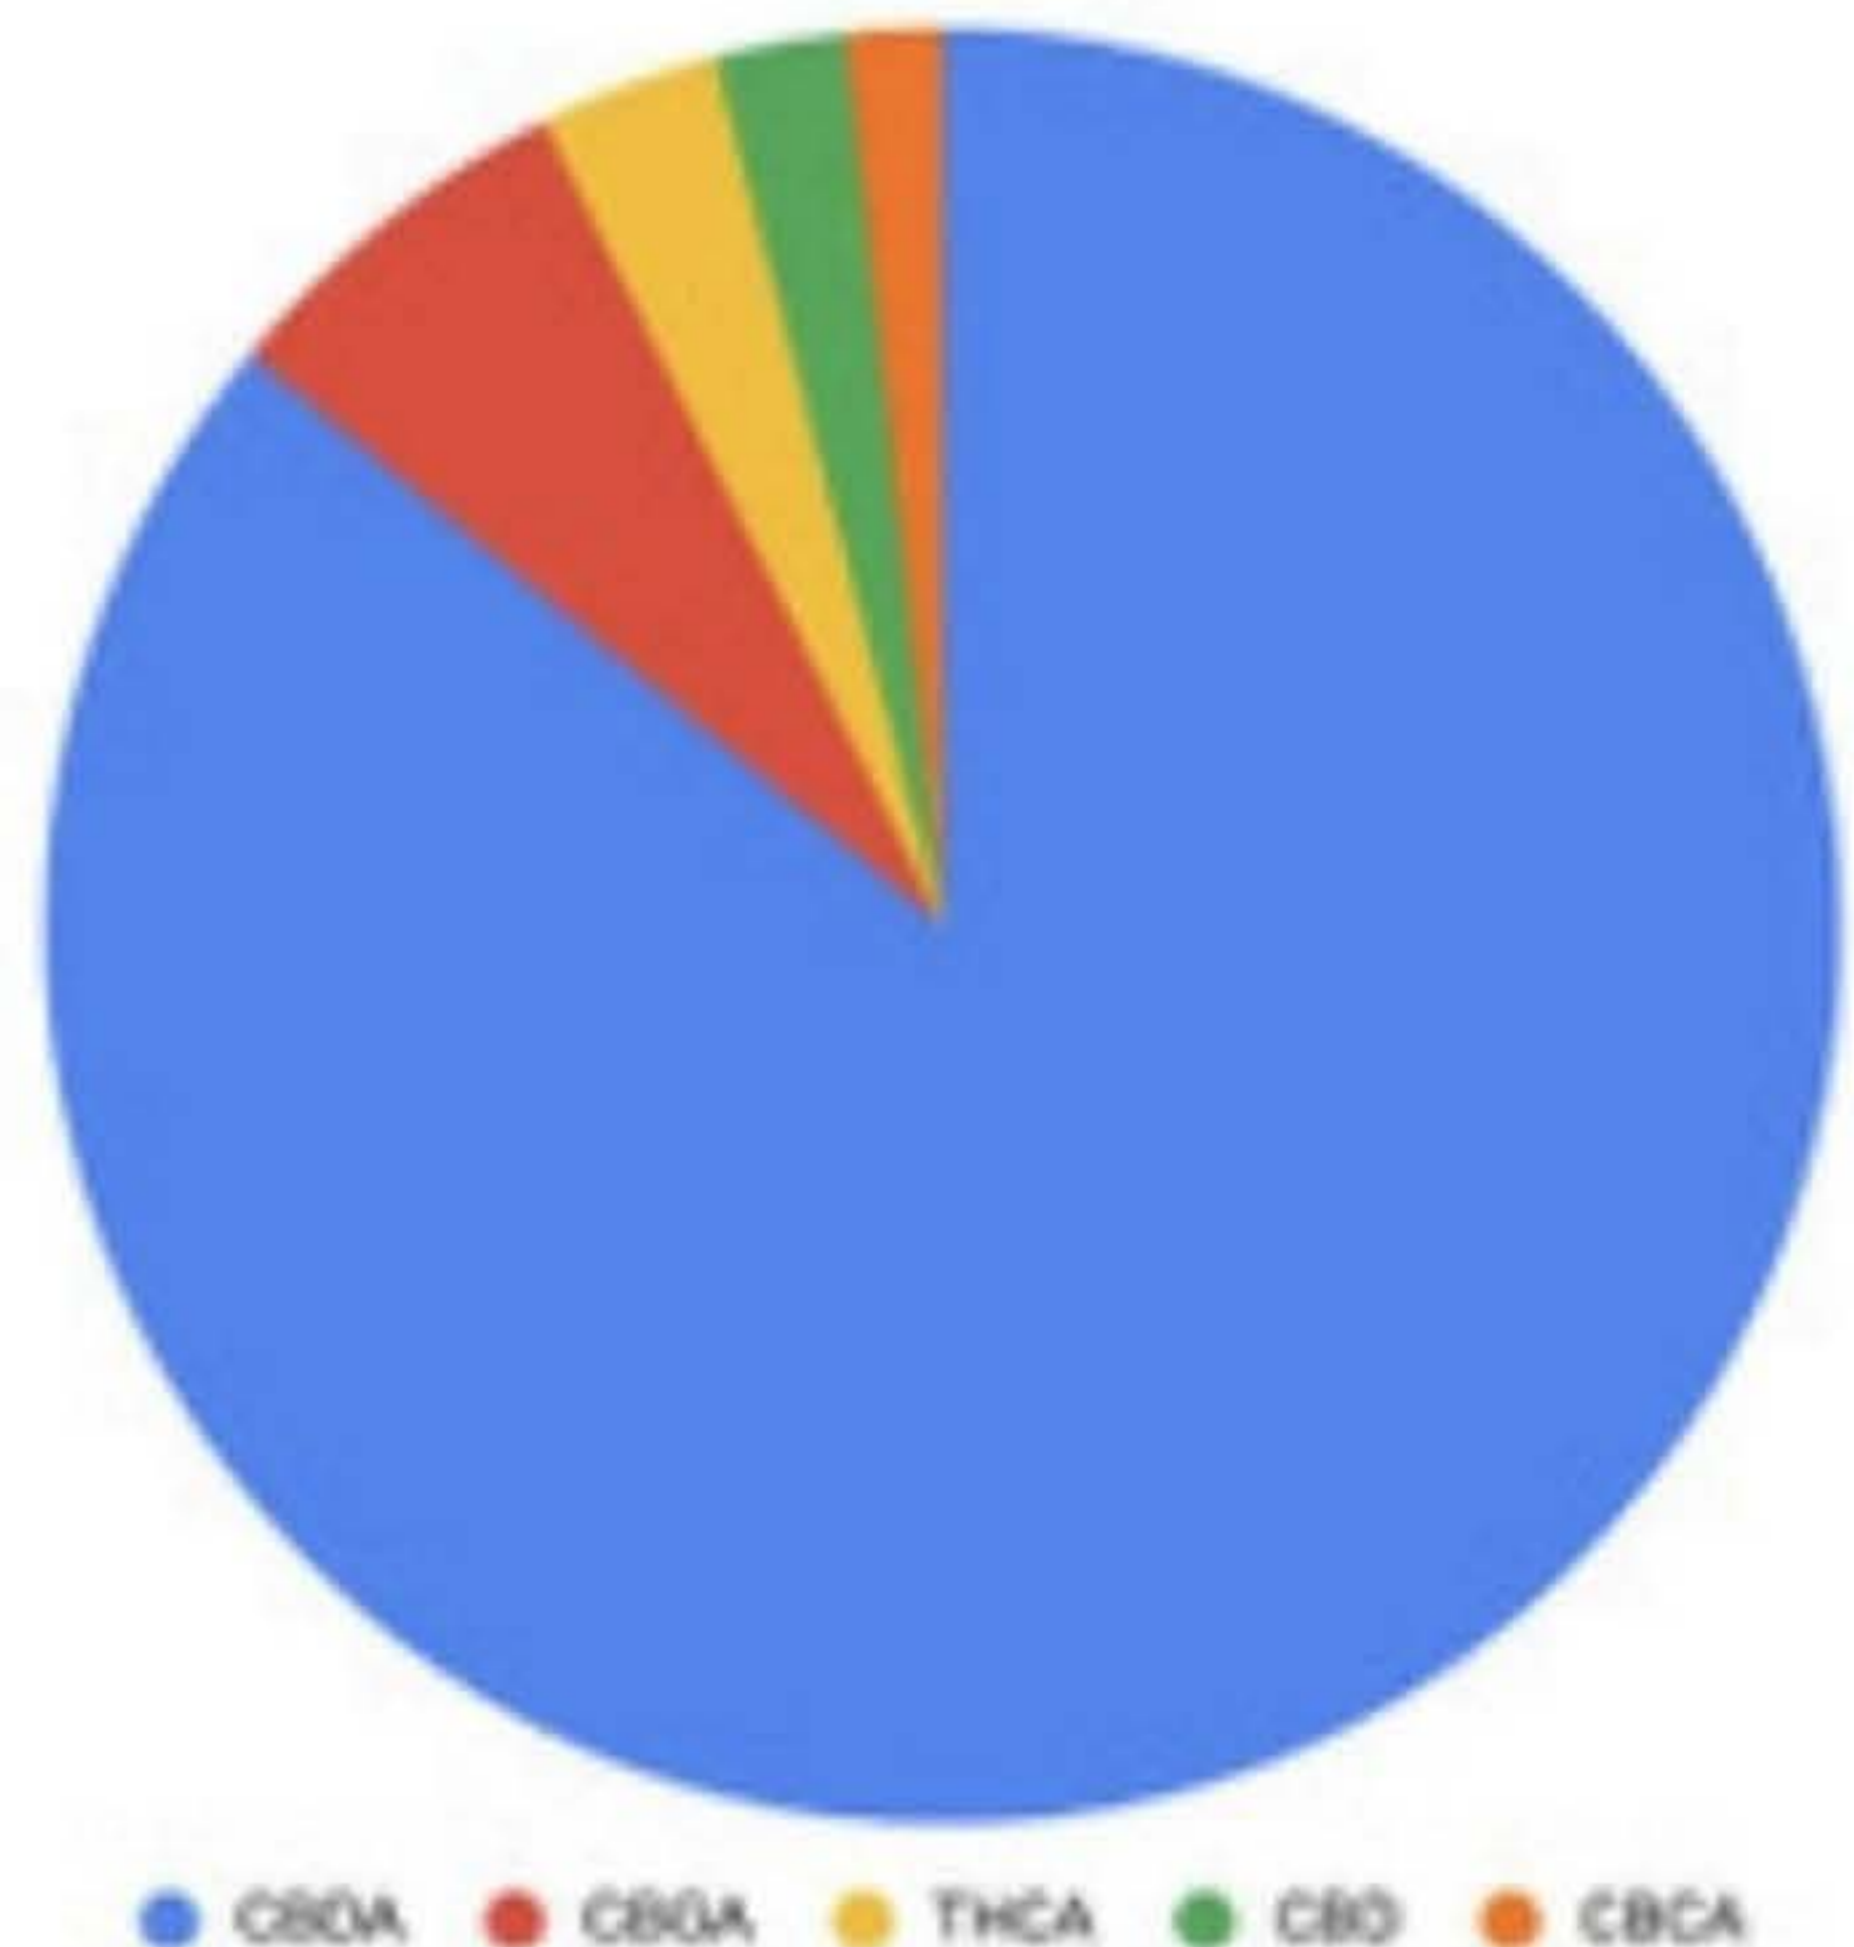

● CBDA
 ● CBGA
 ● THCA
 ● CBD
 ● CBCA

Moisture Content - Not Tested

Date: NT	Method: SOP 027
Analyte: NT	Method: SOP 027

Moisture Content (%): Not Tested

Water Activity - Not Tested

Date: NT	Method: SOP 027
Analyte: NT	Method: SOP 027

Water Activity (aw): No Test

LOQ = Limit of Quantitation, ND = Not Detected, NT = Not Tested. Total THC and Total CBD are calculated in accordance with Oregon reporting requirement (OAR 333.064.0001). For cannabinoid analysis, only CBDA, CBD, THC, THCA, and Δ8-THC are ORELAP accredited analytes. Cannabinoid values reported for plant matter are corrected for dry weight. Oregon water activity action level is 0.85aw and moisture content action level is 12%. Shown values have been rounded to 3 decimal digits, whereas calculations are performed with all available digits. LOQ values based on LOQ study available upon request. This report shall not be reproduced, unless in its entirety, without approval from Professional Testing Labs, Inc. Test results relate only to the sample material analyzed. Results valid for 1 year after test date.